Electrical Energy Assessment
at ity:

Matthew Bechtel

Figures and Tables

Figure 1	Wind Turbine Configurations	21
Figure 2	The Cost of Wind Energy	26
Figure 3	Survey Results: Campus Light Conservation behavior	39
Figure 4	Survey Results: Campus Computer Conservation Behavior	39
Figure 5	Survey Results: Home Light Conservation Behavior	40
Figure 6	Survey Results: Campus Computer Conservation Behavior	40
Figure 7	Survey Results: Potential of Signage	41
Figure 8	Survey Results: Personal Response to Signage	41
Figure 9	Survey Results: Knowledge of Costs	42
Table 1	Survey Results: Assessment of Campus Lighting	42
Table 2		

I. THE INS AND OUTS OF ELECTRICAL ENERGY SOURCES

Electricity can be produced from many different fuel sources, both conventional and

Maryland, approximately 53% of our energy is generated from coal, 33% from nuclear, 8% from natural gas and 2% from hydroelectric power (Reliant Energy undated). All of these sources have both positive and negative attributes associated with their retrieval and use; however, improved practices assist in making th

environmentally friendly alternatives to conventional fuels. Renewable resources, such as wind, sunlight, and biomass, can be used to generate energy and produce relatively little pollution. Technological developments in wind power, solar power and bioenergy are making these resources increasingly viable in regional, national, and global markets.

Conventional Power Sources

Hydroelectric Power

***Basics*:** Hydroelectric power, or hydropower, is a renewable energy source that relies on water cycles. The first record of using water to assist in manpower was in 200 B.C. when the first water wheel was built (Crawford et al. 2004). However, it was not until 1882 that water was used to generate electricity (Crawford

generated by hydropower (Bonsor 2004). This energy source provides over one billion people with more than 650,000 megawatts of power, equivalent to the power provided by 3.6 million barrels of oil (Bonsor 2004). Hydropower can be a very efficient way to generate electricity. Ninety percent of the energy provided by flowing water can be converted into electricity for about $0.85 per kWh (WVIC 2004). This is 50% of the cost of nuclear power and 25% of the cost of natural gas power (WVIC 2004).

Retrieval and Use: Once the gates of a hydropower dam are opened, water is released from the reservoir and flows into a pipe that leads to a turbine (Bonsor 2004). The force of the water turns blades within the turbine, which forces the water up a shaft into a generator (Bonsor 2004). Within the generator, magnets turn concurrently with turbine blades (Bonsor 2004). The magnets pass by copper coils that move electrons to create an alternating current (Bonsor 2004). This is transformed into a high voltage current and sent through a series of power lines to distribute the electricity (Bonsor 2004).

The fate of the water after exiting the turbine is dependent on the type of hydroelectric power plant. Conventional power plants carry water through a pipe or a series of pipes, which discharge downstream (Bonsor 2004). Pumped-storage power plants use water from an upper reservoir to generate electricity and then release it into a lower reservoir (Bonsor 2004). During off-peak consumption hours, the water is pumped back into the upper reservoir via a reversible turbine (Bonsor 2004).

Environmental Considerations:

renewable resource, hydropower has several ecological consequences. The dams required to harness hydroelectricity have many impacts, including armoring, downstream erosion, alteration of local hydrology due to operating rules, and the loss of biodiversity (Roberge 2004).

Armoring, the process of removing the smaller stream sediment particles from the ecosystem leaving only larger cobbles and boulders, occurs due to fast moving waters released from dams (Roberge 2004). Floods created by dams do not occur in small, repeated frequencies as in natural processes, but instead in extremely forceful, uncommon patterns (Cave 1998). As a result, those organisms that inhabit small intricate habitats are no longer able to survive in the river (Cave 1998).

state dam safety agencies to procure equipment, implement new technology, and inspect more frequently (ASCE 2003a). It also provides funds for continuing education for dam safety engineers and funds technological research (ASCE 2003a).

Research is being done on how to mitigate adverse effects on the environment (DOE 2004a). Scientists from The United States Department of Energy (DOE) have been studying fish habitat, fish survival in turbines, water quality downstream of dams, and the response of fish to physical stresses such as hydraulic shear and pressure changes (DOE 2004a). Advanced turbine research has produced improvements to some existing turbines, as well as an innovative turbine runner with a helical screw shape, patterned after centrifugal pumps (DOE 2004a). Due to lack of funding, most of the efforts at the DOE are concentrated on advanced turbine research (DOE 2004a). Biological design criteria based upon laboratory tests of fish stress responses have also been developed (DOE 2004a). Future DOE research projects include computational fluid dynamics modeling and biological testing to quantify turbulence and strike effects on fish (DOE 2004a).

The most important future need is regular maintenance and technological upgrades of current plants (ASCE 2003a). There are over $1 billion in maintenance and upgrading backlogs for hydropower plants (ASCE 2003a). While over 90% of the nation's approximately 100,000 dams are state-regulated, over half of these dams are privately owned (ASCE 2003b). Unfortunately funding (state or private) is erratic, severely inhibiting efforts to rehabilitate dams (ASCE 2003b). Deterioration of dams and hydropower plants causes them to be more susceptible to failure and increases possible negative environmental impacts (ASCE 2003b). Continued downstream urbanization coupled with aging dams and hydropower plants requires that dams are fully funded and staffed in order to prevent possible catastrophic events (ASCE 2003b).

Future Directions: The future of hydropower lies in the creation of new technologies, public policy and grassroots activism. The DOE and The United States Army Corps of Engineers are researching new technologies to reduce the impacts on wildlife, plants and hydrological systems (ASCE 2003a). In addition, there is a growing movement to remove dams that are no longer in use by working at local, state, and national levels to educate the public and do restoration work (Am Rivers 2004).

New technologies may make hydropower a safer and less invasive source of renewable energy. By the year 2010, the DOE is hoping to upgrade aging equipment, retrofit hydropower plants at existing (but unused) dams, and to produce hydropower at sites without the use of dams (DOE 2004a). In addition to upgrading of older equipment, testing is being conducted on large turbines, new tools are being created to improve water use efficiency, and best practices for environmental mitigation are being compiled (DOE 2004a).

If hydropower plants were maintained and kept up-to-date a powerful change in electricity generation could occur (ASCE 2003a). Increased competition due to deregulation in conjunction with advanced environmentally friendly technologies, such as microturbines, fuel cells, and photovoltaics, could give utility companies the ability to generate their own electricity instead of buying it and then redistributing it (ASCE 2003a).

Coal

Basics: Coal is an extremely plentiful and inexpensive form of fuel, often used for generating electricity. Approximately 52% of the electricity in the United States is generated by coal (EIA 2004c). The average family of four would use 3,375 lbs of coal per year to heat an electric water heater, 560 lbs to run an electric stove top, and 256 lbs of coal for a television; totaling over two

tons of coal per year (EIA 2004c). Coal consumption in the United States is expected to rise to about 1,500 million tons in 2025 (EIA 2004d). Globally, usage will increase over the next twenty years to meet growing energy demands (Keay 2002).

Retrieval and Use: Two methods are used to extract coal. The first method, underground mining, involves sinking a horizontal and vertical shaft into the ground. Miners then travel through the shaft or tunnel to dig for coal (Energy Quest 2002). The second method, strip mining, starts with removal of the overlaying soil and vegetation in an area, followed by blasting and removal of the bedrock (Energy Quest 2002). Cranes at the top of the stripped mountain are used to take out the coal (Energy Quest 2002). When mining is complete, the layers of topsoil are replaced (Energy Quest 2002). Strip mining provides 60% of the coal used in the United States, while the remaining 40% comes from underground mines (UCS 2001). The process of producing electricity from coal is relatively simple. Coal is burned to heat water, which produces steam that turns a turbine, which produces electricity (Energy Quest 2002).

Environmental Considerations: Coal is damaging to the environment when it is mined, transported, stored and burned (UCS 2001). For instance, in order to produce steam, coal fired power plants draw in massive amounts of water from surrounding tributaries (UCS 2001). This results in water quality degradation and often destroys many fish and fish eggs (UCS 2001). In addition, coal storage can contaminate groundwater and surface water with metals, sulfuric acid and other contaminants (UCS 2001). Water used to clean the smoke stacks is strongly acidic, and can contribute to acid rain as well as potentially seeping into the groundwater table (UCS 2001).

emissions by 90% and particulate matter to a level that cannot be traced; also, efficiency is improved by almost 40% (Burnett 2001). In addition, this initiative includes a research program with the objective of developing new technologies that will turn pollutants into safe, commercially valuable products, and limit the emissions of greenhouse gases (WCI 2002).

The Clean Power Act has been proposed in the Senate, and would decrease mercury emissions by 90% by 2008 (Novak 2004). The main goal of this legislation is to lower air pollution from coal burning power plants by requiring coal power plants to reduce emissions of nitrogen oxide, sulfur dioxide, carbon dioxide, and mercury in a manner which is fair, cost efficient and technically feasible (Novak 2004). Economically, jobs associated with the coal industry would be eliminated as other forms of energy production are emphasized (Novak 2004).

dioxide and mercury by 2010 with further reductions by 2018 (WCI 2002). Using a market based approach, the plan calls for a cut, by 2018, in sulfur dioxide emissions by 73%, nitrogen oxide emissions by 67% and mercury emissions by 69% (WCI 2002).

Future Directions: Although environmental issues concerning the use of coal for electricity will continue, the fact that coal is cheap and plentiful will drive its usage well into the 21st century (Burnett 2001). It will no doubt play a major role in supplying not only electricity to the United States, but to the rest of the world as well (Burnett 2001). The technological improvements that are being developed have the potential to reduce negative environmental effects, and ensure that coal will continue to be used in electricity generation (Burnett 2001).

Nuclear Power

Basics: In 2003, nuclear power plants produced 20% of the electricity generated in the United States (NRC 2003a, EIA 2004a). Worldwide, the United States ranks 19th in generating

which is most commonly used for energy production, has a half-life of 713 million years (UCS 2003). As uranium decays in nature, it turns into lead (UCS 2003).

The process of mining uranium is similar to coal mining, with both open pit and underground mines (UCS 2003). The amount of uranium concentrate used in the United States was two million pounds in 2003; however, this number is declining each year (EIA 2004b). In order to be used in a nuclear reactor, uranium must be transformed from an ore to solid ceramic fuel pellets and finally to rods (NEI 2004a). This processing involves several steps: mining and milling, conversion, enrichment, and fabrication (NEI 2004a).

First, uranium is mined and transported to a conventional mill where the ore is turned into uranium oxide or yellowcake and packaged (NEI 2004a). In the next step, yellowcake is shipped to a conversion plant where it is converted chemically to uranium hexafluoride (NEI 2004a). Uranium can be enriched by two different methods: gaseous diffusion and centrifuging (NEI 2004a). Gaseous diffusion, the method most commonly used in the United States, allows gaseous uranium hexafluoride to pass through a barrier that separates the isotopes of uranium by weight (NEI 2004a). The second method also separates the isotopes by weight, but in this method centrifugal force is used (NEI 2004a). In the fabrication process, the enriched uranium is converted into uranium dioxide powder and pressed into fuel pellets (NEI 2004a). At this point the fuel is ready to be used in the reactors (NEI 2004a).

Nuclear power plants generate electricity through the process of fission, which involves splitting the atoms of heavy elements such as uranium or plutonium into lighter elements. In this

There are two types of light water reactors: boiling water reactors and pressurized water reactors (NRC 2003a). All existing commercial reactors are light water reactors (Wardell 2001). Light water reactors use water as a coolant to remove heat produced from a reactor core during nuclear fission (NRC 2003d). Water is also used as a moderator to reduce the speed of neutrons produced in nuclear fission in order to allow for a controlled sustained chain reaction (NRC 2003d).

In order for fission to occur inside a light water reactor, uranium concentrate is needed (NEI 2004a). This uranium is generally formed into cylindrical pellets, which are arranged into fourteen-foot-long metal rods (NEI 2004a). The rods are bundled together and hundreds of bundled rods are lowered into a pressure vessel, which is usually made of steel (NEI 2004a). Inside the pressure vessel, uranium atoms give off neutrons, some of which crash into other uranium atoms, splitting them, generating heat, and freeing more atom-splitting neutrons (Wardell 2001). The heat from this reaction heats water which drives a steam turbine, forcing generators to spin and produce electricity (FEPC 2004).

Continuing fission beyond this point causes the system to overheat, causing an extremely hazardous situation. Control rods, which absorb neutrons, are used to prevent overheating and control excessive fission (Hostetter 2002). The rods are consistently raised and lowered to regulate the rate of reaction (Hostetter 2002).

In typical boiling water reactors, a single loop directly delivers steam from a pressure vessel to the turbine and returns water to a reactor core to cool it (NEI 2004a). The same water loop serves as a steam source for turbines (NEI 2004a). However, in pressure water reactors, the primary water loop transmits heat through the tube walls to the surrounding water of the secondary cooling system to generate steam, and the secondary loop delivers steam to the turbines. Even though there are differences between boiling water reactors and pressure water

reactors, the overall system, which produces steam to rotate turbines, is the same (FEPC 2004). In the United States, sixty-nine of the104 reactors are classified as pressure water reactors and thirty-five are boiling water reactors (EIA 2004b, IAEA 2004b).

Environmental Considerations:

-safety storage

(UCS 2003). Currently, only two sites accept low-level waste: Barnwell in South Carolina and Hanford in Washington (UCS 2003). Estimated decommissioning costs range from $133 million to $303 million per reactor, but so far no large reactors have been decommissioned (UCS 2003). A number of reactors are in storage waiting to be decommissioned at a future time (UCS 2003).

The Chernobyl disaster was the only accident in the history of commercial nuclear power where radiation-related fatalities occurred (WNA 2004). The accident destroyed the Chernobyl-

Policy Implications:

ant nuclear accident occurred at the Three Mile Island facility in March 1979 (EIA 2000). Since then, public opinion seems to have changed regarding the use of nuclear power (NEI 2003). A recent survey conducted for the Nuclear Energy Institute found that 64% of Americans favor the use of nuclear power to generate electricity, although only half of those surveyed favor construction of new nuclear power plants (NEI 2003). Despite this split in public opinion over the construction of new nuclear power plants, a consortium of nuclear plant operators and manufacturers may apply for a license to construct a new nuclear power plant at a yet undetermined location (Wald 2004). The last year in which a new commercial nuclear power plant became operational in the United States was 1996 (IAEA 2004a).

The Nuclear Regulatory Commission (NRC) is the federal agency responsible for regulating the operation of all commercial nuclear reactors in the United States (NRC 2003a). The NRC oversees the licensing process for all nuclear power plants, including the application for new licenses and the renewal, transfer, and amendment of existing licenses (NRC 2004). The NRC also oversees safety at commercial nuclear facilities through inspection, evaluation, and enforcement of operating regulations (NRC 2004).

Future Directions:

There are two methods in which the natural gas is converted into electricity (EPA 2004). The most common practice is to burn the natural gas in a boiler to produce steam to generate electricity (EPA 2004). A more efficient method to produce electricity involves burning gas in a combined cycle combustion turbine (EPA 2004). This process burns the natural gas in a combustion turbine and then uses the hot combustion turbine exhaust to create steam to drive a steam turbine (EPA 2004). This method achieves a much higher efficiency by using the same fuel source twice.

Demand for natural gas is becoming so high that it risks outpacing supply. If utilities are to keep up with demand, infrastructure will need to be improved to assure an adequate supply (DOE 2003a).

*UHHQ6RXUFHVRI3RZHU

-increasing aspect of the energy industry market. Public attitudes in favor of green power are shifting the energy industry toward cleaner, more environmentally conscious ways of producing energy (Zahorsky 2004). Alternative fuels have become more popular as sources of energy because they have the potential to stimulate local economies, reduce greenhouse gasses, and lower dependence on foreign oil (Cotton et al. 2004). The primary sources of green power are solar, wind, and biomass. Burgeoning technologies in these areas are already contributing to local and national economies and being incorporated by utility companies.

Wind Power

Basics: Humans first became interested in harnessing the power of wind approximately 2200 years ago when the first windmill was constructed to assist in food production and the drainage of lakes for water consumption (EERE 2004a). The Danish first used wind turbines in 1890 to

increased and is now one of the fastest growing and cleanest sources of renewable energy (EERE 2004a).

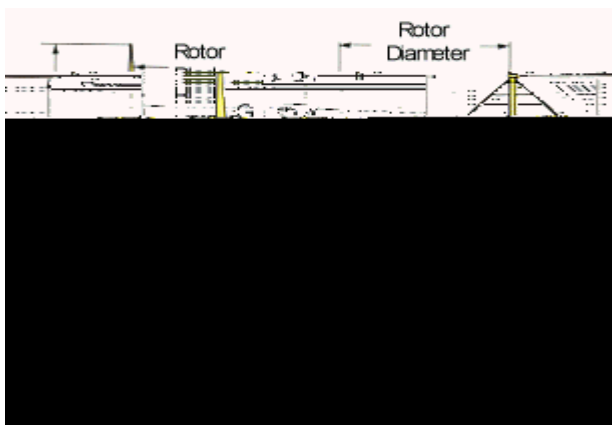

Figure 1 Horizontal-axis turbines are comprised of a rotor or blades, drive train, generator, tower, and electronic equipment (AWEA 2004a).

rises, cooler air moves in to take its place, creating wind. Since air has mass, its movement is a form of kinetic energy that can, in part, be converted into mechanical or electrical energy (EERE 2004b). Windmills are the mechanism for harnessing wind to do mechanical work, such as pumping water. Energy systems using wind to generate electricity are called turbines and are becoming more widely used to supply electricity to residential, commercial, and industrial sites (AWEA 2004a).

energy market, most systems used by utilities are composed of horizontal-axis or propeller-style turbines, which are manufactured in a range of sizes and power capacities (EERE 2004b). Vertical-axis, or egg-beater, style turbines are less common, but share the same mechanisms for wind energy conversion (AWEA 2004a). The components include a rotor or blades which convert wind force into rotational shaft force, a drive train and generator, a tower supporting these structures, and necessary electronic equipment (Fig. 1) (AWEA 2004a). The amount of energy produced by a turbine depends on the diameter of its rotors as well as wind speed. For example, a turbine with a diameter of 71 meters has the capacity to produce nearly 124 times the power of a 10-meter diameter turbine (AWEA 2004a). Turbines used for land-based utilities and in offshore wind harvesting systems can have diameters as large as 110 meters (AWEA 2004a). Most often, turbines are not referred to by their diameter, but by their

power rating, which generally ranges from 250 watts to 1.8 megawatts depending on size (AWEA 2004a).

The average American household uses 10,000 kilowatt-hours of energy per year, roughly the amount of power that can be generated annually by a 10 kilowatt (kW) turbine under average wind speed conditions of 12 miles per hour (AWEA 2004a). Under the same wind conditions, a 1.8 megawatt (MW) turbine generates enough power to support more than 500 households

- l output, usually have power ratings between 700 kW and 1.8 MW. A wind energy facility with 10, 1.8 MW turbines could produce up to 18 MW, or enough to theoretically power 4,300 to 5,400 households (AWEA 2004a). In reality, variant wind speeds cause fluctuations in power production, and as a result, wind energy utilities are currently paired with other energy sources to provide more consistent utility service (AWEA 2004a).

Economic Perspectives: Proponents of wind power tout this renewable energy source as positively contributing to the economy by providing jobs, generating nonpolluting fuel, and being virtually resistant to inflation because it is free and ubiquitous (AWEA 2004a). Currently, more than 2,000 people are dire(y)20( )-9(ra)7(tl)-mpow sourrd in(he)4(o)-9(pow)-inETBT1 0 0 1 310.4962m[3

is not necessary to privately own turbines to benefit from wind energy. The least risky way to

).

Social Perspectives: Wind power generally garners popular support, with 80% of people polled in favor of it and 5% against it (AWEA 2004a). Surveys show that social attitudes are favorable toward wind power and wind farms because this energy source is believed to be clean, safe, and ubiquitous (Simon 1996). Pollution and hazardous wastes gener(r)-on 1996a24(e)4(is f(a)4ne)4(r)-belionvrnd h

alternative fuels, but are skeptical or fully opposed to this plan. Opponents, such as the Alliance to Protect Nantucket Sound, are concerned about aesthetic impacts and the degree to which bird life would be affected (Leaning 2004).

Environmental Perspectives:

one of two prospective wind power initiatives being considered in the state (AWEA 2004b). This and other efforts to increase the use of wind power in the region will likely benefit from progressive policies set forth by the United States DOE.

Future Perspectives: In 2003, the United States DOE set forth a six-year wind energy plan which aimed to promote renewable energy development and viability primarily through bettering technologies, reducing costs, and increasing the attractiveness of green power in the energy marketplace (DOE 2003b). For example, in 2010 the DOE plans to aid sixteen states in the installation of at least 100 MW of wind turbines, and in 2012, the DOE plans to establish guidelines that would prime wind energy for competition in the national energy market (DOE 2003b). The DOE has established a goal of 100 gigawatts (GW) of wind energy to be used in the approximately three quadrillion Btus per year of primary energy, which in turn could displace an annual 65 million metric tons of carbon emissions (DOE 2003b).

New technologies for wind power are on the horizon. Improvements to turbine efficiency and output will allow for low speed winds to generate the same amount of power as current turbines harvest from high-speed winds (DOE 2003b). This technology would allow more states distributed wind technology, which would allow smaller wind turbines to be constructed in areas where there is not enough land to construct

Solar Energy

Basics: Solar energy is a renewable energy source that uses sunlight to produce electricity. Energy from the sun provides the equivalent of 10,000 times the current global energy demand while creating little to no air pollutants (CAT undated). In 1999, renewable energy sources accounted for only 13% of the global energy demand, with solar energy only accounting for a small fraction of that percentage (Solarbuzz 2004). Currently, even after rapid growth of solar energy use, it only accounts for less then 1% of global primary energy demand (Solarbuzz 2004).

In 1839 a French scientist discovered the possibility of solar power when he noticed that light increased the current of a simple battery (CAT undated). Thirty-four years later, it was discovered that selenium was light sensitive and had the ability to conduct electricity (CAT undated). These two discoveries sparked the research that led to the first selenium-based solar cell (CAT undated). However, solar energy did not get much recognition until the 1950s when Bell Laboratories developed the silicon-based solar cell, which had low efficiency and was expensive to produce (CAT undated). In 1991, a more efficient system was developed by Ron Swenson who built and introduced his solar car at the Denver Grand Prix (Ecotopia 2004).

Solar-thermal and photovoltaic (PV) technologies are the two basic ways to convert solar energy to electricity (EPA 2004). Solar-
reflective or absorbent devices to heat a liquid, creating vapor that is then used to turn a generator and create electricity (EPA 2004). PV systems consist of semi-conducting cells that release energy when struck by sunlight (EPA 2004). The leading commercial semi-conductive material is crystalline silicon, which is based on silicon, the predominant semi-conductor material used in electronics and computer industries (Azom 2004). The atomic properties of semi-

electron volts. The electrons are then able to enter into the conduction band and become part of an electrical current to power electrical appliances (Quinn 1997).

Environmental Perspectives: The use of solar energy itself has minimal environmental impacts, yet issues have arisen regarding manufacturing, installation and disposal processes. For example, PV cells can be made with arsenic, cadmium and silicon, and should be considered hazardous materials and be treated accordingly (UCS 2004). However, with proper handling, solar energy use has few environmental impacts (UCS 2004). Assuming proper techniques are employed producing electricity with PV cells emits no pollution, produces no greenhouse gases and uses no finite fossil fuel resources (Azom 2004).

Some risks arise during manufacturing, disposal or recycling of PV components. The most significant health risks are confined to those who directly interact with the components in manufacturing plants and disposal areas (EPRI 2003). Inhalation of dust particles containing various heavy metals and toxins could cause lung disease and other respiratory illnesses (Azom 2004).

conventional building materials. Roofing materials, for example, can now be replaced by PV

the energy stored within organic matter such as wood, paper, corn stalks, algae, and even manure (Carless 1993). These organic waste products are collectively called biomass. Today, the use of bioenergy goes beyond simply using combustion to produce heat. Not only can biomass be used to produce electricity, but it can also be used to produce liquid or solid fuels and chemicals (Carless 1993, DOE 2004d).

Biomass crops are usually harvested, dried, and then shipped to their destination where they are converted into energy (Borowitz 1999). Various technologies are used to convert biomass into energy, including combustion, thermochemical conversion, and biochemical conversion (Carless 1993). The primary by-product of many of these technologies can be either gas, liquid, or solid fuel (Carless 1993). Of these technologies, the one that is most commonly used to produce electricity is combustion (ORNL undated).

Any type of biomass is suitable for combustion, as long as it contains less than 60% moisture (Carless 1993). Currently, in the United States, power plants that use direct combustion have a capacity of up to ten GW (DOE 2004f). Co-firing is another form of biomass combustion that involves the burning of biomass along with fossil fuels in power plants (DOE 2000, DOE 2004f). Co-firing reduces dependency on fossil fuels and harmful emissions of nitrogen oxides and sulfur dioxides (DOE 2000). The burning of biomass with coal is one of the least expensive renewable energy options (DOE 2004f).

A more contemporary technology that can be used to produce electricity is termed gasification, a type of thermochemical conversion (Carless 1993, ORNL undated). This method involves a partial combustion of biomass in a low oxygen environment in order to produce a mixture of gasses, which can then be used as fuel for driving a gas turbine (Carless 1993, DOE 2004f). Gasification has several advantages over combustion of biomass. First, gasification can take advantage of a wider range of fuels (ORNL undated). Instead of using wood and wood

2004g). In rural communities, small biopower facilities can employ local residents, use local crops, and produce clean energy (DOE 2004g). Building biomass plants could result in a reduced need for fossil fuels, which in turn could mean greater energy independence for countries which do not have fossil fuel reserves (Carless 1993). In addition, a reduction in pollution and greenhouse gas emissions could benefit public health and the environment (DOE 2004i).

There is no one type of biomass that is most appropriate for energy production. Depending on the climate and amount of land available, different types of biomass are going to

crops require less fertilization and one-tenth of the herbicides and pesticides of agricultural crops (ORNL undated). Biomass crops also have the potential to act as stream buffers, and thus could be used to prevent erosion and absorb excess nutrients often associated with traditional agricultural practices (ORNL undated).

Although there are many benefits associated with bioenergy, there is also cause for concern. It is possible that farmers will not plant and harvest biomass in a sustainable way, thus depleting land and forest resources (Carless 1993). Some are concerned that old growth forests and fragile wetland ecosystems will be vulnerable to biomass harvesting (Carless 1993).

***Current Perspectives*:** Worldwide, the use of biomass for energy varies greatly. In countries such as Denmark and Sweden, biomass accounts for as much as 10% of energy production (Borowitz 1999). In many developing countries, the proportion is much higher; for instance, India produces 56% of its energy using biomass (Borowitz 1999). Before coal and oil became readily available in the United States, biomass was the primary source of energy (Carless 1993). Today, however, biomass accounts for only 4% of energy production in the United States (Borowitz 1999).

Between 2000 and 2003, biomass was the leading source of alternative energy in the United States (DOE 2004e). The most commonly used biomass fuels are agricultural and forestry by-products, particularly from paper mills (DOE 2004e). Other materials can be used as well, such as herbaceous and woody plant crops, aquatic crops, municipal wastes, and animal wastes (DOE 2004e). The United States Department of Energy (DOE) is responsible for the development of technologies that will allow biomass to become a more readily used resource (DOE 2004i). The DOE Biomass Program focuses not only on the production of electricity, but

also on the use of biomass to create fuels and chemicals (DOE 2004i). Their goals are to increase the presence of biorefineries and to reduce dependence on foreign oil (DOE 2004i).

Future Perspectives: Bioenergy has great potential. In the United States, production of bioenergy is based on direct combustion (DOE 2004f). New analytical and evaluation techniques, as well as increased genetic manipulation of crops is allowing for better fuels to be grown on poorer land (DOE 2004d). This has the potential to decrease costs and to improve environmental quality (DOE 2004d). The ideal bioenergy crop would be photosynthetically and water efficient, able to grow with little or no fertilizer, and disease and pest resistant (Borowitz 1999). Bioenergy holds great promise for producing clean, economical, renewable energy. Although biomass is a renewable resource, the degree to which it is sustainable will depend on the methods implemented by farmers (Carless 1993).

II STATE OF THE CAMPUS

The Energy Usage Survey

Introduction:

Materials and Methods

An attempt was made to survey all members of the community in proportion to their distribution on the Towson campus. The composition of the University is 84% students, 6% faculty, and 10% staff (TU 2000). Convenience sampling was used. Members of the class went to places on campus where they were likely to meet different members of the community. Sampling sites included

Question 18 *What do you think might make other people more willing to conserve electricity on campus?*

1) No answer
2)
3) Signs/ Awareness/ Education
4) Raise tuition
5) Lower tuition
6) Increase Fees
7) Pay own bills
8) Other

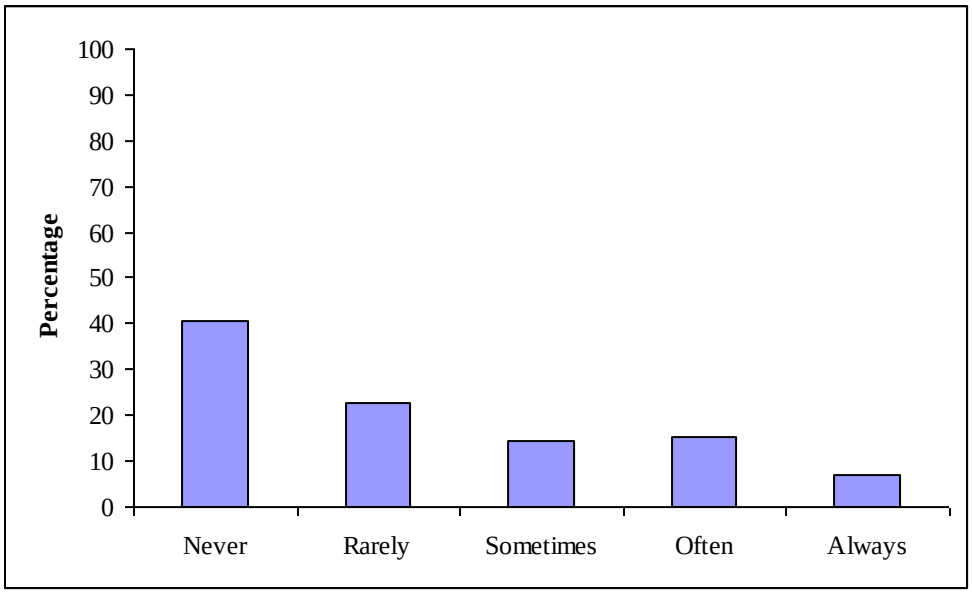

Figure 3 The responses of survey participants to statement 6 - lights out in a classroom whe
presented above.

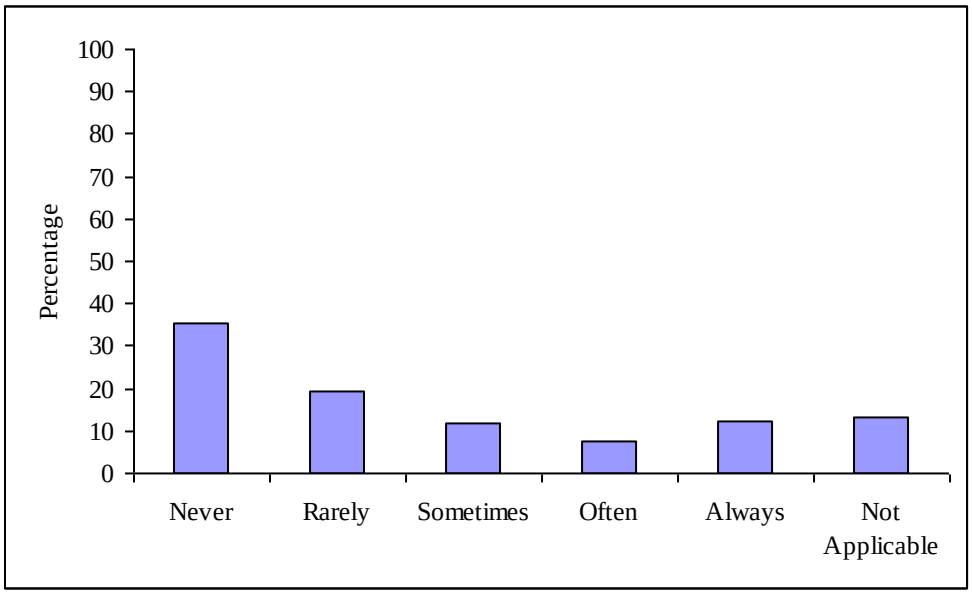

Figure 4 The responses of survey participants to statement 10 When I am done

above.

Interestingly, respondents do care about energy usage in their own homes. Over 88% of

home (Fig. 5) and over 55% answered

computers when they are finished using them (Fig. 6).

off are effective

The data suggests that education and increasing awareness about the role of energy usage on campus would be an effective means of influencing energy conservation behavior on campus. Over 44% of the respondents did not know whether or not the cost of electricity had declined over the past five years (Fig. 9), reflecting a general lack of knowledge about energy cost, efficiency, and usage.

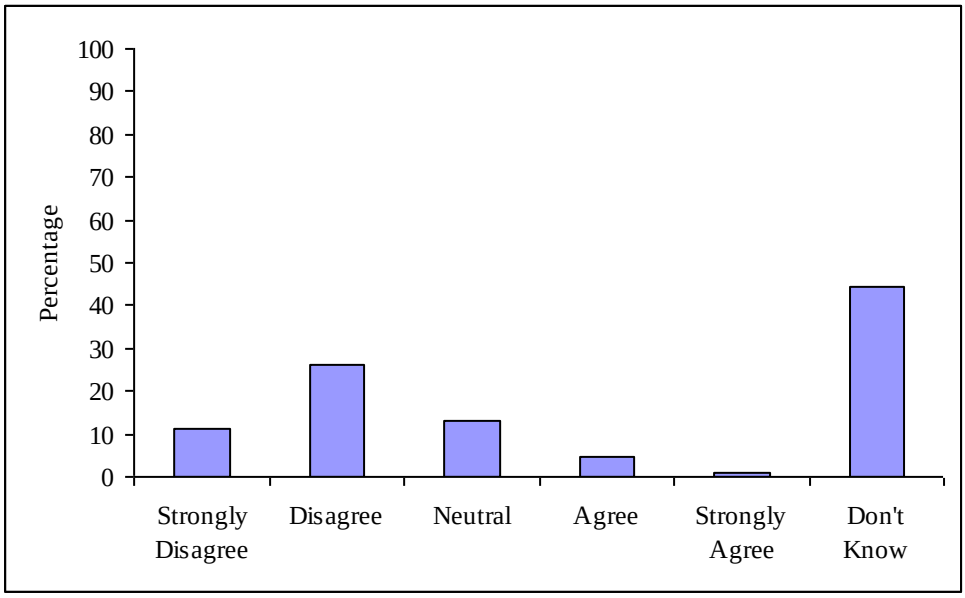

A large portion of those surveyed stated that the level of lighting on campus is fine (Table 1). Still a quarter of the faculty and students answered that campus pathways are too dark and a quarter of the students answered that classrooms are too well lit. This clearly suggests areas where lighting levels can be lowered and where they need to be improved.

Table 1. The responses of survey participants to question 16-

	Unidentified	Staff	Faculty	Students
No Answer	10.0%	11.8%	15.8%	25.9%
	10.0%	19.1%	24.6%	23.9%
Lighting is Fine	10.0%	7.4%	3.5%	23.9%

Every group surveyed felt that implementing education or awareness programs would be the best way to promote energy conservation (Table 2). The majority of respondents in each group also said the campus could employ new electrical technologies as well as turn off lights and computers when they are not in use to reduce campus consumption of electricity (Table 3).

Table 2. The responses of survey participants to question 18-ed below.

	Unidentified	Staff	Faculty	Students
No Answer	40.0%	44.1%	45.6%	33.0%
	0%	0%	3.5%	8.0%
Signs/ Awareness Programs/ Education	0%	2.9%	7.0%	10.2%
Tuition Increases	0%	7.4%		

Conclusions and Suggestions

The survey results suggest it is important to educate people and increase awareness among members of the Towson University community about the amount of energy usage on campus, its impact on their environment and its impact on their daily lives. The survey established that the members of the Towson community may not be aware of the amount of money spent on electricity and therefore are less likely to be involved in actions to reduce electric consumption. The survey suggests that signs or incentives that encourage people to take an action to turn off the lights and computers would be effective in reducing energy usage on campus.

The survey results should be considered when deciding upon methods of reducing electrical waste. Technology is only one part of the solution. For technology to be effective, community members must feel they have a stake in the process and be actively involved in making changes. A model protocol that combines education and technology could help Towson University successfully reduce campus electrical consumption.

in Smith Hall. Two hundred and eighty-five of these computers are used by faculty. The remainder are located

A survey was conducted to determine how computers and monitors are managed by faculty during off-peak hours. Specifically, faculty in Smith Hall were asked if they turned off equipment at the end of the day. In addition, a visual inspection of computer usage in the

monitor was measured using a PL-100 Plug Load Analyzer (manufactured and provided by Watt Stopper, Inc.).

Results

Light Usage: The classification, size, and 2003 actual electrical consumption for Glen Tower B, Cook Library, Enrollment Services, and Smith Hall based on university electric bills are shown in Table 9 (McKee 2004).

Table 9. The classif

Table 10. The percentage of sampling period for the *On + Vacant* usage

Computer Usage: Approximately 60 faculty responded to the e-mail survey. Faculty survey responses indicated that 53.3 % of the computers and 61.7 % of the monitors were left on overnight. These data appear to be consistent with the campus-wide survey, which found that 55% of the students and faculty surveyed never or rarely shut down computers when they are finished. Assuming that all faculty in Smith Hall practice similar off-peak computer management to those responding to the survey, it is estimated that of the 285 faculty computer systems, 152 computers and 109 monitors are left on when not in use. A visual inspection of computer labs in Smith Hall showed that 96.9% (125) of the computers and 99.2% (128) of the monitors were left on when not in use.

The power consumption of a typical computer and monitor were measured at forty-eight watts (W) and seventy-one W, respectively. The estimated amount of electrical energy wasted (Table 12) was determined by using these values, assuming that 66.9% (277) of the computers and 73.4% (304) of the monitors in Smith Hall are left on when not in use.

Table 12. Presented below is the estimated energy wasted per year due to computers and monitors being left on while not in use in Smith Hall, where wasted energy per year equals the number of system components left on while not in use multiplied by the number of hours per year the system components are not in use (6,680 hours) multiplied by the power consumption of the system component. Not in use hours are based on 2,080 hours of use during an 8,760-hour year.

System Component	Percentage On While Not In Use	Power Consumption (W)	Wasted Energy Per Year (kWh)
Computer	66.9 (277)	48	88,817
Monitor	73.4 (304)	71	144,181
Total			232,998

IDEAS FOR THE FUTURE

Computer Power Management

University computers and monitors use more electricity than all other forms of office equipment combined (Energy Star 2004c). Instead of paying utility bills for computers that are kept on all day and night, it makes sense that schools and universities should only have to pay for the time they are in use (Energy Star 2004c).

Monitors

During periods of inactivity, computer monitors can go into a low-power sleep mode (Ryan undated). This does not interfere with downloading or network connections and performance is not sacrificed (Ryan undated). When a user touches the keyboard or mouse, the

d capacity (Ryan undated). This low-power sleep mode is standard on all new computers sold today (Energy Star 2004a).

Making sure this feature is employed across a large institution poses a challenge. There have been programs developed to implement power management across networks, including one distributed through the EPA calledr0b5[(d C4sTBT()-3(1w((R)-19)3(dd a)-5(c/e)6p217 shi)-3(on)-6(Pd7(e)4ws

a full refund of license and maintenance fees if Surveyor has not achieved a minimum energy savings of 120 kWh per PC per year (Wise 2004).

Verdiem: A Viable Option for Towson?

An audit of computers and monitors was conducted to find out if implementing power

per year (Table 13).

Table 13. There are 414 computers in use in Smith Hall, a science building which houses classrooms, offices and research laboratories. The kWh used and potential savings from installing a power management system are presented below.

Current computers and monitors situation	Amount of kWh used for computers and monitors
Per unit kWh consumption	1042
Total consumption all units	431,388
Estimated power wasted based on data collected.	232,998
Potential savings with power management	198,390

Fees for installing Surveyor on PCs in Smith Hall would be $9,108 for the first year but will amortize in about 7.9 months at $0.07 per kWh (Table 14). (Calculations can be found in Appendix VII).

Table 14. Presented below are current usage figures and potential savings at two different billing rates with power management enabled on computers and monitors in Smith Hall.

Cot2480C6(t o)-7(f

Although a wide variety of occupancy sensors are available, only information for models manufactured by Watt Stopper, Inc. (Santa Clara, CA) were used. From the available product literature, models that were most suited for each of the applications were selected (Table 16).

Table 16. Presented below are proposed occupancy sensor models, price per unit, number of units required, and total cost of sensor installation. Occupancy sensors are from Watt Stopper, Inc, Santa Clara, CA. The price per unit includes the sensor

Reduced Energy Lighting Technologies

Easylite

One means of saving energy is with a computer controlled fluorescent light dimming system manufactured by Easylite. The Easylite system reduces the cost of lighting from storage to office and educational purposes and is capable of reducing energy consumption and increasing system control. Similar technologies do not allow dimming of fluorescent lights; they simply turn the lights on or off (Fisher 2004). Turning fluorescent lights on and off on an irregular basis affects the longevity of bulbs (Fisher 2004). Dimming fluorescent light bulbs could possibly extend the life of the bulb (Fisher 2004).

The Easylite system is controlled from one main computer that can handle up to 64,000

-

r

2004). Easylite dims output to a lower level, causing the light to draw less power and watte gu

- Wall Mounted Dimmer/Occupancy Sensor Allows the user to have more control over the system
- Power Link A twenty-Amp line voltage relay used to control non Easylite fixtures
- DC Analog Control Loop Ballast powered and util

Based on the information gathered from the campus audit, the potential for reduced electricity consumption from this type of technology is possible. If the ligh?0B (c)4(on4ouhe poput .)-sBTtd

bulb 2003). This light draws approximately 2.3 W and provides a brightness of 11,000 Lux (Super-Bright LED bulb 2003).

There are also LED ceiling drop lights designed to replace in-ceiling fluorescent fixtures (TheLEDlight.com undated). These drop lights are capable of producing a light output of 130 W while drawing 360mA/hr and retail for $840.00 per unit (TheLEDlight.com undated). In addition to these, there are a wide variety of replacement LED bulbs styles (TheLEDlight.com undated). LEDs bulbs can last up to twenty-five years depending upon the quality of the bulb (Resculite.com 2004). While this form of lighting is quite expensive, they draw only one-third to one-tenth of the power drawn from conventional lighting sources (TheLEDlight.com undated, Super-Bright LED bulb 2003).

LED lights are well suited for applications in exit signs. Despite the fact that they are low wattage, exit signs consume a large amount of electricity simply because they are on twenty-four hours a day. LED exit signs last 100% longer than incandescent exit signs (EPA 2001). In the late 1990s, Towson replaced many exit signs in many of the academic buildings with LED exit signs (see Table 18) (Bohlayer 2004). Exit signs were counted in Hawkins Hall, Psyc

Table 18. Presented below is a count of exit signs in selected Towson academic buildings.

BUILDING	LED	NON-LED	TOTAL
Hawkins Hall	32	0	32
Psychology	25	0	25
Towson Center			

and staff, and because of this the bulk of educational programs should be directed towards students.

One method to incorporate conservation education at Towson is to place an annual article in the Towerlight, the campus newspaper. A brief article could outline sources of locally available electricity and the environmental damage and health risks associated with these sources. It could also emphasize the rising cost of electricity and offer simple ways to save through energy efficient light bulbs and wise computer use. The article could also describe what Towson has done so far to conserve energy and how much energy and money the university has saved as a result of these efforts.

It became apparent, through the survey data, that some community members are uncertain when they should shut off computers and lights. Towson University can save energy by sending a clear message regarding when it is appropriate to shut off the lights or computers in a room. This message could be sent out through the Daily Digest or the Towerlight. In addition, readable signs could be posted outside of classrooms or near light switches instructing people to turn off the lights or computers.

Another possibility to educate the campus is to distribute manuals or informational brochures on campus. This brochure would be brief and contain energy saving information and suggestions that are applicable both on and off campus. For instance, the brochure could offer information about energy efficient products such as lights, mini-fridges, and computers. This brochure could address common energy myths and misconceptions.

The university could also take a more active role by setting up booths or giving out information at events such as TigerFest and freshman orientation. If students are introduced to campus life with conservation in mind, they will have more opportunity to apply that information over the course of their school career. Distributing information at annual events such as

TigerFest will reinforce the energy conservation message. At these events it may be possible to r stickers and other paraphernalia with catchy

Another way to reinforce the conservation message would be to air informative but radio station. For instance, a program might involve students answering energy related trivia, and awarding a prize to the winner. It might even be possible to get students involved in conservation through activities such as dorm-based contests, in which the dorm that conserves the most electricity is awarded a prize. Students might even be engaged by periodic energy saving seminars.

Lastly, Towson University could work closely with the campus club, Students for Environmental Awareness, to support activities on campus that encourage energy conservation. Members could be encouraged to introduce innovated conservation measures, or could hold an annual contest for the most effective conservation idea (SEA 2004).

Energy Conservation Efforts by Other Universities

Conservation is not only good for the environment; it also has the potential to save large sums of money. This is especially significant for large institutions such as universities, whose electricity costs include the powering of many academic, administrative, and residential buildings. In its efforts to conserve electricity Towson University is a part of the ranks of conservation minded universities across the country.

rde energyoring por(si)y(Un)] TJETBT1 0 068 393024 157.1 Tm[( )] TJETBT1 0 471 405024 157.1 Tn

ensured financial incentives for saving energy in construction design and systems, and promised

task lighting (such as small table top lights) when overhead florescent lights are excessive, adjusting window blinds to maximize the use of sunlight

not needed (SUNY undated b). SUNY-Buffalo found that as many as 50% of corridor lights could be removed while still maintaining adequate light levels (SUNY 1996).

The University of Washington has promoted and developed ways to conserve electricity for close to a decade (The University of Washington 2003). In January 2001, the University of Washington created the Conservation Project Development Team at Facilities Services to implement several energy and water reduction measures (Roseth 2002). The energy audit reported that thirty-eight campus buildings had lights that were not in effective use, and de-activated them (The University of Washington 2003). This resulted in an energy consumption reduction of 4,290,445 kWh per year, which translates to $214,500 in savings (The University of Washington 2003). Other implementations and programs include the cutting back lighting by 25% during operation of Husky Stadium, adjusting library lighting shutdown hours, and pu University of Washington Medical Center staff and faculty (The University of Washington 2003).

Many other universities have taken steps to conserve energy by more efficiently managing computer equipment. Universities such as Pennsylvania State University and Tulane University have tackled this issue by joining the Million Monitor Drive (Energy Star 2004b). The Million Monitor Drive is an Energy Star campaign to activate monitor power management on at least one million computer monitors (Energy Star 2004b). Joining requires pledging to activate power management on all monitors, organization-wide (Energy Star 2004b).

SUNY-Buffalo also began a Green Computing Campaign, which published a Green Computing Guide (SUNY 1996). The guide contains many energy saving suggestions, dispels

University undated). A typical beverage vending machine uses 3500 kWh per year, compared to a residential refrigerator, which uses 450-800 kWh per year (Tufts University undated).

The University of Washington is using this type of technology as well, called vending misers (The University of Washington 2003). Each of the 200 campus cold-drink machines has been retrofitted with these devices (

After fifteen minutes if the motion sensor does not sense anyone, the vending miser will shut the machine off and powers back up when someone walks by (Tufts University undated). Vending misers do not influence the internal thermostat or the compressor (Tufts University undated). Initial tests show that energy savings could be up to 50%. (Roseth 2002).

It is possible to use energy conservation as an educational tool. In January 2001, Pennsylvania State University installed a solar rooftop system on the roof of the Main Building of Penn State Delaware County (PSU 2001). This system will not only produce energy, but will be monitored through the Internet (PSU 2001). This information can be incorporated into relevant courses and will allow students to examine relationships between energy, the sun, and the environment (PSU 2001).

Technologies of the Future

Hybrid Lighting Technologies

In the future, hybrid lighting may be of interest to Towson University. Hybrid lighting is a system in which sunlight is piped into a building via fiber optic cables and is used as a source of light along with fluorescent lighting. Currently the Oak Ridge National Laboratory is developing hybrid lighting (Minkel 2004). Rotating forty-six inch mirrored dishes are used to focus light into fiber optic cables which run to the interior of the building where light fixtures

emit a mixture of sunlight and fluorescent light (Minkel 2004). These fibers are made of a silicone gel that transfers light far more efficiently than other commonly used fibers (Minkel 2004). Once inside, the sunlight is diffused through an acrylic light

CONCLUSION

We undertook this project with the full cooperation of Facilities Management, an office at Towson University aware of the importance of being environmentally and economically responsible. In the late 1990s, Facilities Management updated the lighting fixtures in all Weoope ofat ount r wo(terk in t)-13(s ne)-3(emesCente)3wfichilsssiSheson Uni4ersityco0(n)senterati academic buildings except for residence halls, Enrollment Services and Towson Center (Bohlayer 2004). The ballasts were changed from magnetic to more efficient electric and light bulbs were changed from T12 to the more efficient T8 (Bohlayer 2004). In addition, Facilities Management has made it a priority to replace obsolete equipment with more efficient technology (Bohlayer 2004). Roofs have been replaced using better materials at Towson Center (1998), Media Center (2003), Dowell Health (2004) and Cook Library (2004) (Bohlayer 2004). Between1995-1997, higher efficiency chillers and boilers were installed in the power plant (Bohlayer 2004). The continuing mission to manage costs is reflected in the ongoing discussions among the Towson Four (TU, St. Joseph Medical Center, Greater Baltimore Medical Center and Sheppard Pratt Hospital) to consider building an electrical generation plant run by natural gas to supply the needs of the institundsn.s T8 (Bohlayer 2(r)4).

References

4 exits.com. 2003. LED Retro Fit Kits. (2004; http://4exits.com/cgi-bin/miva?Merchant2/merchant.mv+Screen=PROD&Store_Code=4&Product_Code=RFLED&Category_Code=RF).

[ACS] American Chemical Society. 2003. Physical Chemical Principles of Photovoltaic Conversion with Nanoparticulate, Mesoporus Dye-sensitized Solar Cells. (12 December

[EERE] Energy,

[LSA] Latent Semantic Analysis, 2003. What is Coal? (29 October 2004; http://lsa.colorado.edu/essence/texts/coal.htm).

nd the Luxeon Difference. (October 2004; http://www.lumileds.com/pdfs/10Myths1.PDF).

McKee, Leroy. Energy coordinator, Towson University, Towson, MD.

[Tulane] Tulane University. 2004. Contest Rules. (15 October 2004; http://green.tulane.edu/energysmart/ContestRules.html).

[UCS] Union of Concerned Scientists. 2001. (15 October 2004; http://www.ucsusa.org/CoalvsWind/c01.html).

[UCS] Union of Concerned Scientists. 2003. How Nuclear Power Works. (1 November 2004; http://www.ucsusa.org/clean_energy/renewable_energy/page.cfm?pageID=85).

[UCS] Union of Concerned Scientists. 2004. Clean Energy. (15 October 2004; http://www.ucsusa.org/clean_energy/health_and_environment/).

University of New Brunswick. 2000. University of New Brunswick Fredericton Campus: Energy Conservation A Long Term Commitment (27 October 2004; http://oee.nrcan.gc.ca/publications/infosource/pub/ici/eii/pdf/m27-01-1364E.pdf).

Verdiem. 2004a. Surveyor vs. EZ Save: a Head-to-Head Comparison. email, November 3, 2004.

Verdiem. 2004b. Verdiem Customers. (14 November 2004; http://virtual.pnw.com/customers/college.asp).

Wald, ML. 2004. Seven companies band together i nuclear plant in decades. New York Times. A14.

Wardell Charles. 2001. Nuclear Energy Comes Full Circle. POPULAR SCIENCE.

Windustry. 2004. Wind Energy Economics. (November 2004; http://www.windustry.com/basics/05-economics.htm).

Wise, Charlie. 2004. Personal Communication. (Mr. Wise is an Account Manager for Verdium)

[WNA] World Nuclear Association. 2004. Information and Issue Briefs: Chernobyl

APPENDIX 1

THE ENERGY USAGE SURVEY

APPENDIX 1

	Other	0	1	1	1	7

13. I see my peers taking action

APPENDIX II

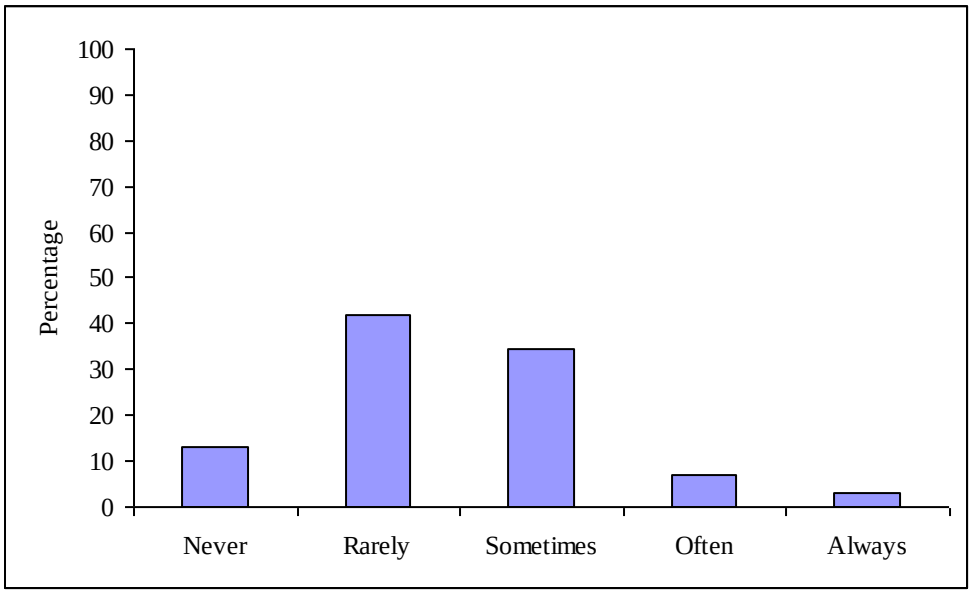

The responses of survey participants to statement 6: "[redacted] action to reduce electrical use."

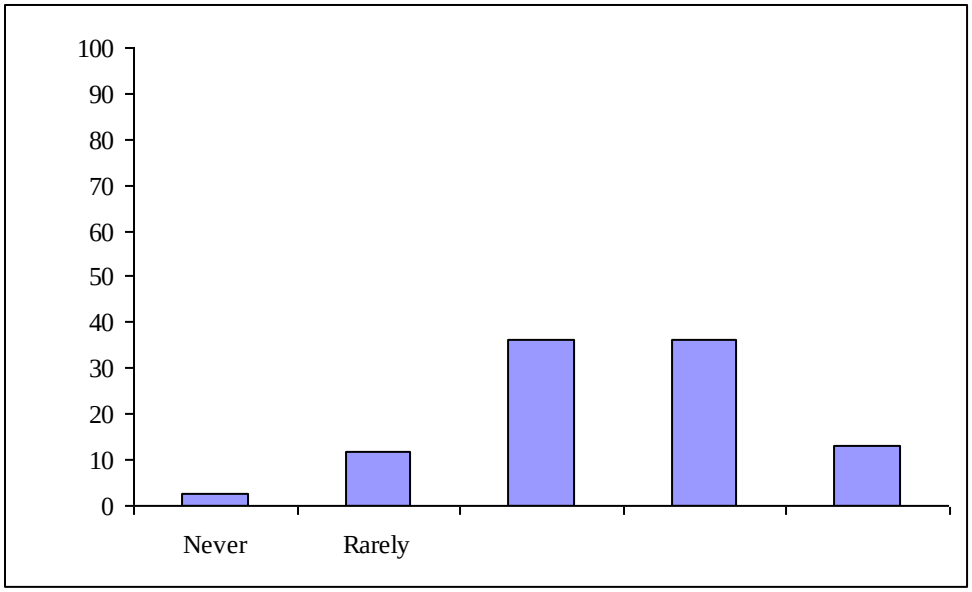

The responses of survey participants to statement 14: "I take actions to reduce electrical use."

APPENDIX II

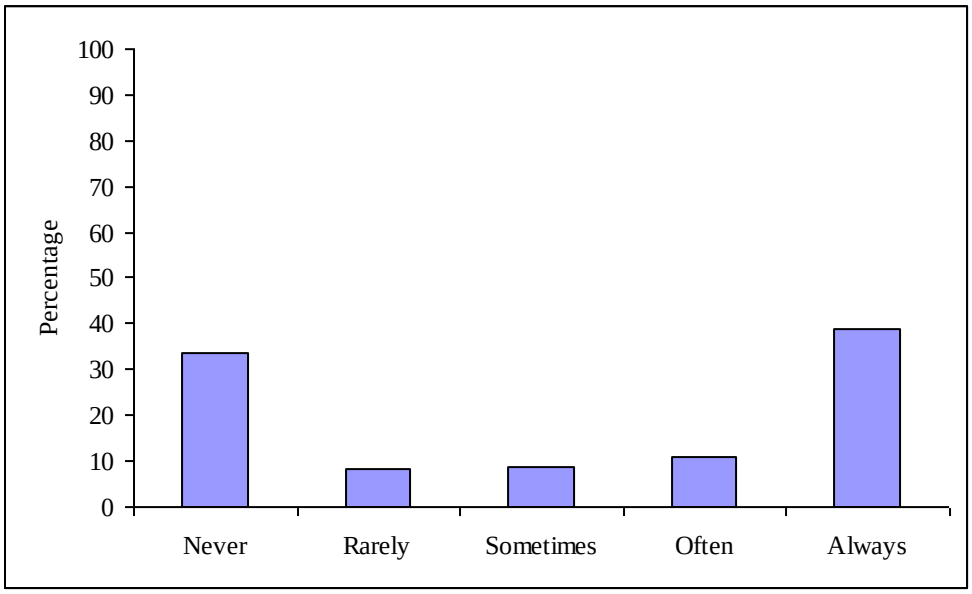

Additional response summaries are found in the tables below.

The responses of survey parti

Statement 7 Responses	Never	Rarely

APPENDIX IV

APPENDIX V

COOK LIBRARY LIGHT SURVEY DATA

Room Classification	Floor ID	Room ID	Fixtures	Tubes per Fixture	Type	Total Tubes	Bulb Wattage	Power (W)
Bathroom	3	304	1	1	2	1	32	32
Bathroom	3	303	1	1	2	1	32	32
Bathroom	4							